


UNCONFINED COMPRESSION TEST

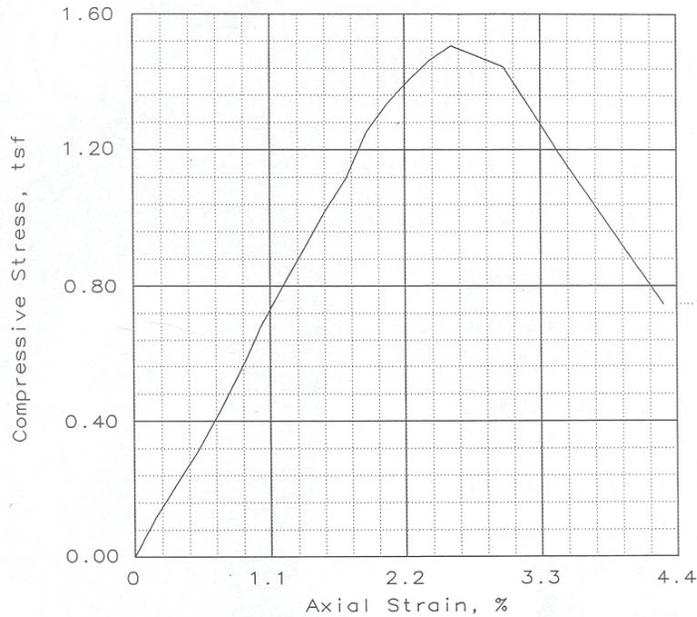

SAMPLE NO.:	1			
Unconfined strength, tsf	1.51			
Undrained shear strength, tsf	0.75			
Failure strain, %	2.6			
Strain rate, %/min	2.00			
Water content, %	24.2			
Wet density, pcf	126.5			
Dry density, pcf	101.8			
Saturation, %	102.7			
Void ratio	0.6252			
Specimen diameter, in	2.85			
Specimen height, in	5.82			
Height/diameter ratio	2.04			


Description: Clay SI Silty Reddish Brown GS= 2.65 Type: Shelby Tube

Project No.: 3-7590-0000-0000
 Date: 20 May 2003
 Remarks:
 Testing Sample @6.5ft


 Fig. No.: 02 UC

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

 UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

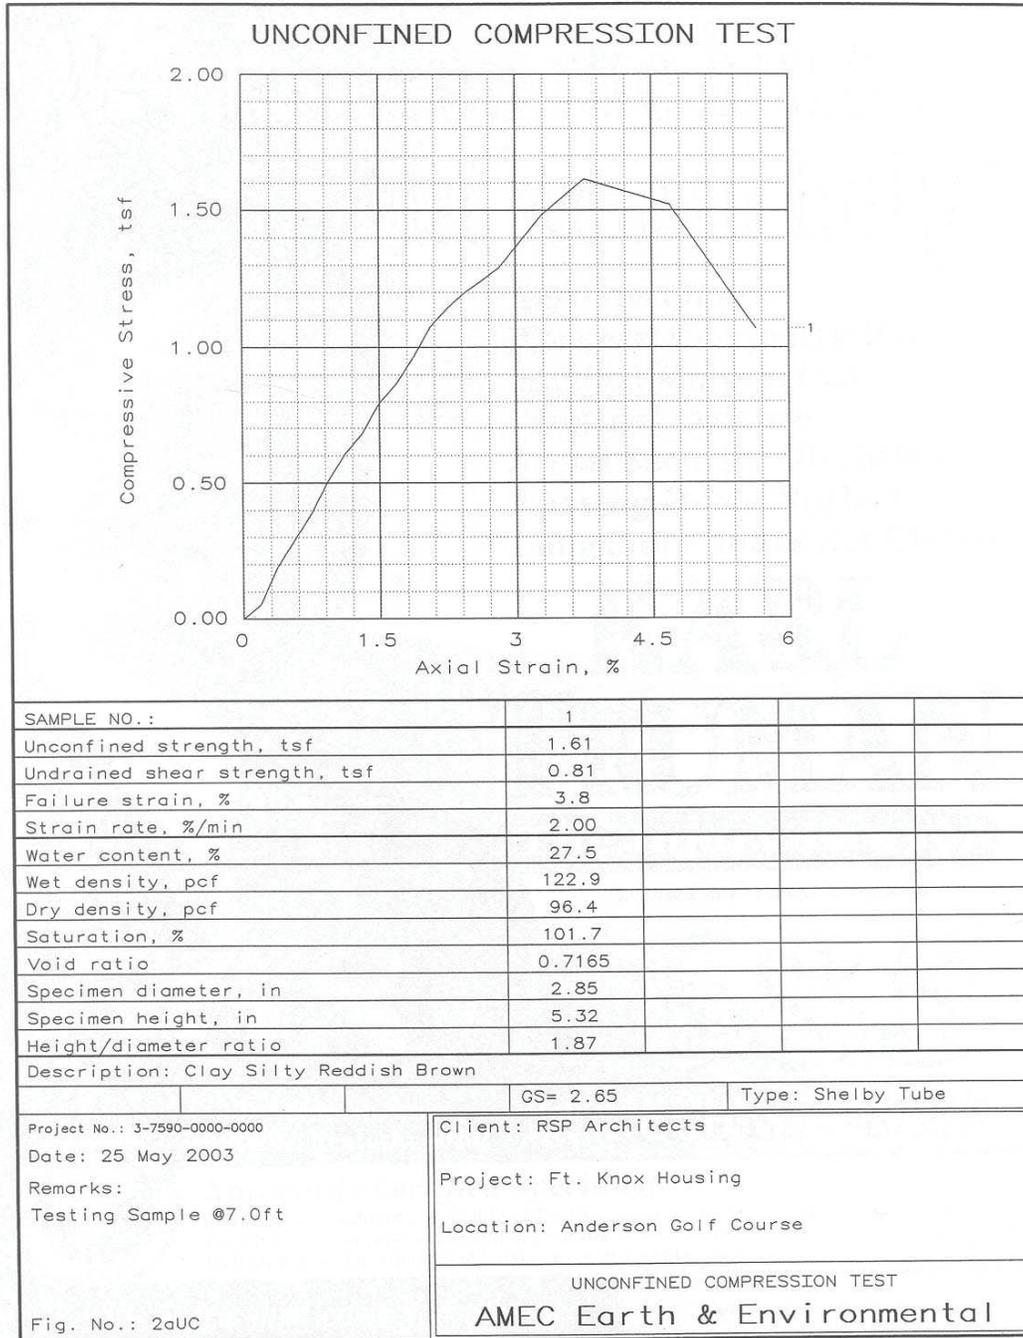

UNCONFINED COMPRESSION TEST

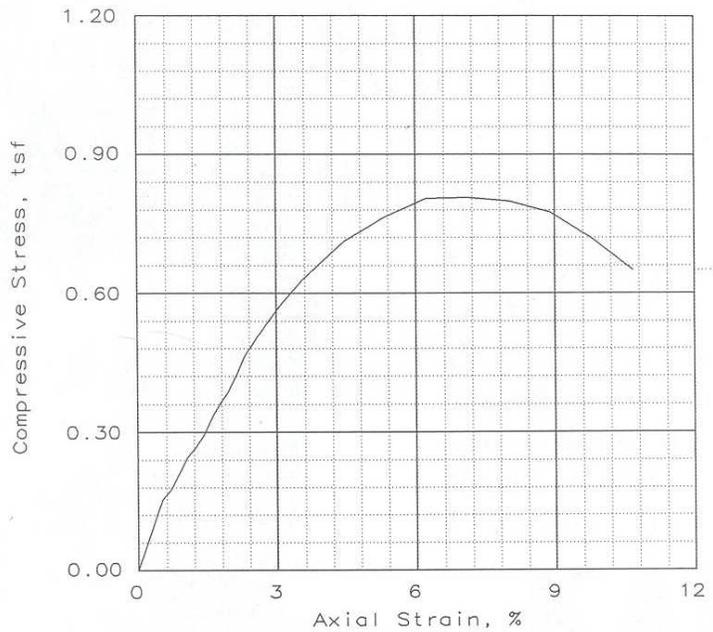

SAMPLE NO.:	1			
Unconfined strength, tsf	0.81			
Undrained shear strength, tsf	0.40			
Failure strain, %	7.1			
Strain rate, %/min	2.00			
Water content, %	24.6			
Wet density, pcf	123.3			
Dry density, pcf	99.0			
Saturation, %	97.0			
Void ratio	0.6712			
Specimen diameter, in	2.85			
Specimen height, in	5.62			
Height/diameter ratio	1.97			

Description: Clay SI Silty Reddish Brown

GS= 2.65 Type: Shelby Tube


Project No.: 3-7590-0000-0000
 Date: 20 May 2003
 Remarks:
 Testing Sample @3.2ft

Fig. No.: 09 UC

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

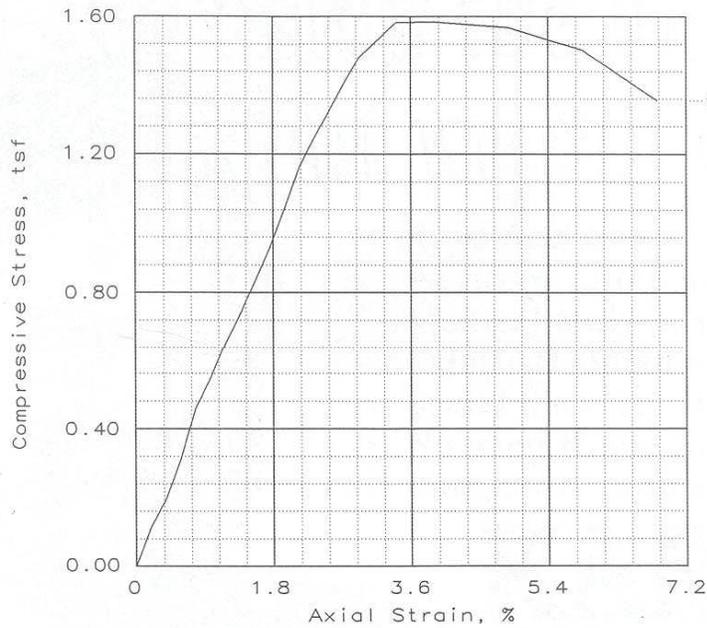

SAMPLE NO.:	1			
Unconfined strength, tsf	1.58			
Undrained shear strength, tsf	0.79			
Failure strain, %	3.9			
Strain rate, %/min	2.00			
Water content, %	28.2			
Wet density, pcf	122.6			
Dry density, pcf	95.6			
Saturation, %	102.5			
Void ratio	0.7300			
Specimen diameter, in	2.85			
Specimen height, in	5.13			
Height/diameter ratio	1.80			

Description: Clay, Sl Silty, Reddish Brown/Tan, W/Nodules
 GS= 2.65 Type: Shelby Tube


Project No.: 3-7590-0000-0000
 Date: 10 May 2003
 Remarks:
 Testing Sample @7.3ft

 Fig. No.: 12 UC

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

 UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

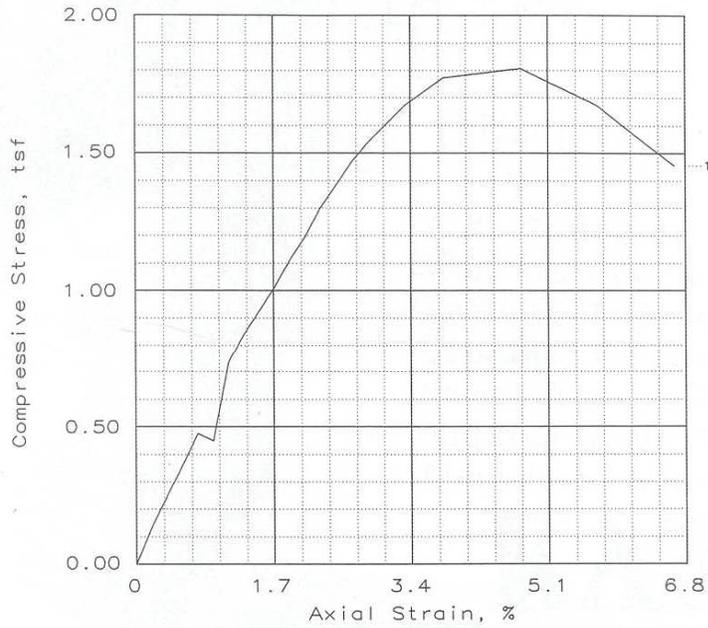

SAMPLE NO.:	1			
Unconfined strength, tsf	1.81			
Undrained shear strength, tsf	0.90			
Failure strain, %	4.8			
Strain rate, %/min	2.00			
Water content, %	25.4			
Wet density, pcf	124.2			
Dry density, pcf	99.0			
Saturation, %	100.3			
Void ratio	0.6702			
Specimen diameter, in	2.85			
Specimen height, in	5.25			
Height/diameter ratio	1.84			

Description: Clay, Sl Silty, Reddish Brown/Tan, W/Nodules

GS= 2.65 Type: Shelby Tube


Project No.: 3-7590-0000-0000
 Date: 10 May 2003
 Remarks:
 Testing Sample @6.8ft

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

Fig. No.: 12aUC

UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

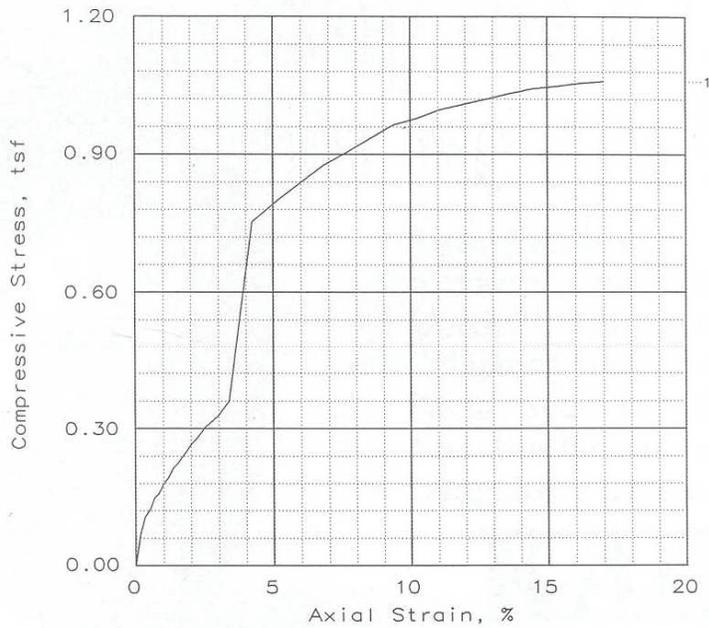

SAMPLE NO.:	1			
Unconfined strength, tsf	1.06			
Undrained shear strength, tsf	0.53			
Failure strain, %	17.0			
Strain rate, %/min	2.00			
Water content, %	23.6			
Wet density, pcf	128.4			
Dry density, pcf	103.9			
Saturation, %	105.5			
Void ratio	0.5917			
Specimen diameter, in	2.85			
Specimen height, in	5.87			
Height/diameter ratio	2.06			

Description: Silt SI Clayey Brown GS= 2.65 Type: Shelby Tube


Project No.: 3-7590-0000-0000
 Date: 20 May 2003
 Remarks:
 Testing Sample @3.2ft

 Fig. No.: 18 UC

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

 UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

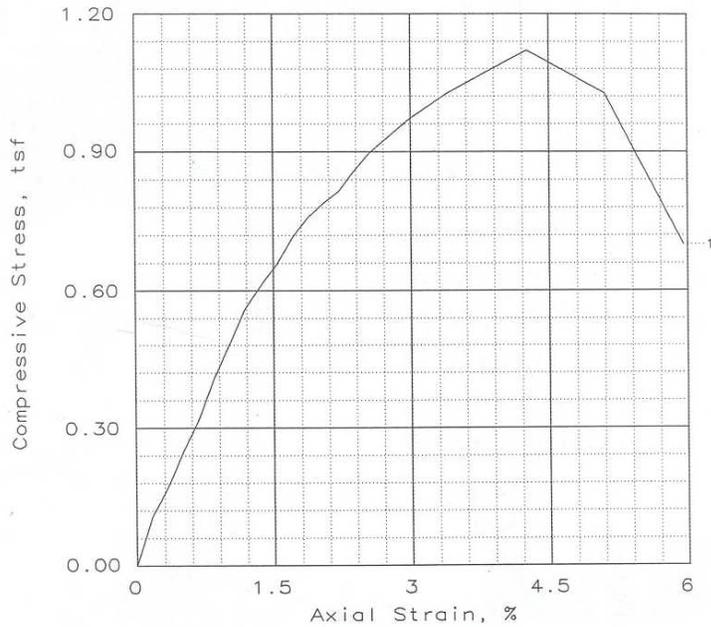


SAMPLE NO.:	1			
Unconfined strength, tsf	1.12			
Undrained shear strength, tsf	0.56			
Failure strain, %	4.3			
Strain rate, %/min	2.00			
Water content, %	34.2			
Wet density, pcf	118.5			
Dry density, pcf	88.3			
Saturation, %	103.8			
Void ratio	0.8737			
Specimen diameter, in	2.85			
Specimen height, in	5.87			
Height/diameter ratio	2.06			

Description: Silt SI Clayey Brown GS= 2.65 Type: Shelby Tube

Project No.: 3-7590-0000-0000 Date: 20 May 2003 Remarks: Testing Sample @4.0ft Fig. No.: 20 UC	Client: RSP Architects Project: Ft. Knox Housing Location: Anderson Golf Course <div style="text-align: center;"> UNCONFINED COMPRESSION TEST AMEC Earth & Environmental </div>
--	--

UNCONFINED COMPRESSION TEST

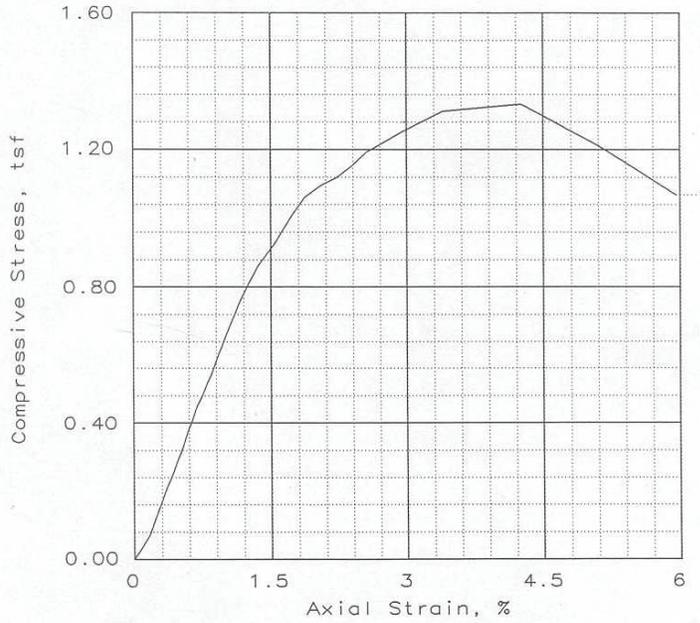

SAMPLE NO.:	1			
Unconfined strength, tsf	1.33			
Undrained shear strength, tsf	0.67			
Failure strain, %	4.3			
Strain rate, %/min	2.00			
Water content, %	41.2			
Wet density, pcf	114.9			
Dry density, pcf	81.4			
Saturation, %	105.6			
Void ratio	1.0332			
Specimen diameter, in	2.85			
Specimen height, in	5.87			
Height/diameter ratio	2.06			

Description: Clay SI Silty Reddish Brown

GS= 2.65 Type: Shelby Tube


Project No.: 3-7590-0000-0000
 Date: 25 May 2003
 Remarks:
 Testing Sample @4.5ft

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

Fig. No.: 20aUC

UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

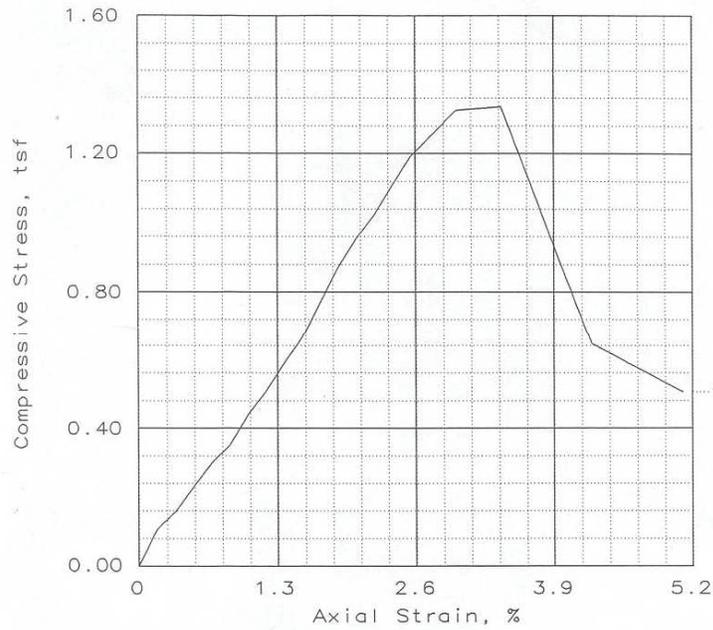

SAMPLE NO.:	1			
Unconfined strength, tsf	1.34			
Undrained shear strength, tsf	0.67			
Failure strain, %	3.4			
Strain rate, %/min	2.00			
Water content, %	18.3			
Wet density, pcf	131.4			
Dry density, pcf	111.1			
Saturation, %	99.1			
Void ratio	0.4885			
Specimen diameter, in	2.85			
Specimen height, in	5.87			
Height/diameter ratio	2.06			

Description: Silt Clayey Reddish Brown SI Sandy GS= 2.65 Type: Shelby Tube


Project No.: 3-7590-0000-0000
 Date: 17 May 2003
 Remarks:
 Testing Sample @7.0ft

 Fig. No.: 21 UC

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

 UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

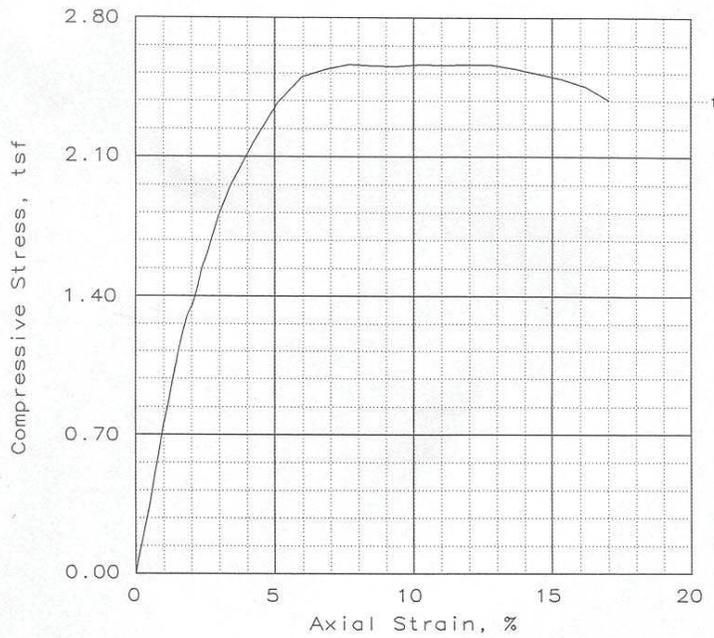

SAMPLE NO.:	1			
Unconfined strength, tsf	2.56			
Undrained shear strength, tsf	1.28			
Failure strain, %	11.9			
Strain rate, %/min	2.00			
Water content, %	20.4			
Wet density, pcf	131.7			
Dry density, pcf	109.3			
Saturation, %	105.5			
Void ratio	0.5130			
Specimen diameter, in	2.85			
Specimen height, in	5.87			
Height/diameter ratio	2.06			

Description: Clay SI Silty Reddish Brown w/Rock

	GS= 2.65	Type: Shelby Tube
--	----------	-------------------


Project No.: 3-7590-0000-0000
 Date: 17 May 2003
 Remarks:
 Testing Sample @3.3ft

Fig. No.: 22 UC

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

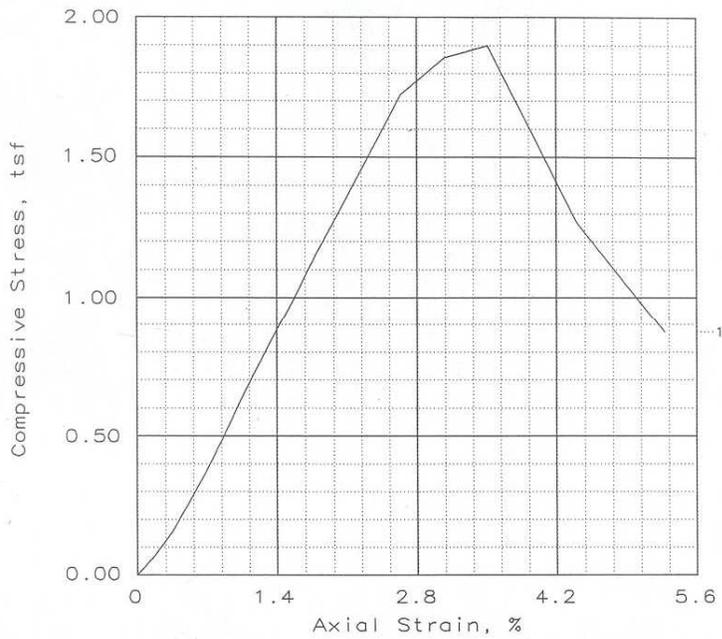

SAMPLE NO.:	1			
Unconfined strength, tsf	1.90			
Undrained shear strength, tsf	0.95			
Failure strain, %	3.5			
Strain rate, %/min	2.00			
Water content, %	25.3			
Wet density, pcf	125.7			
Dry density, pcf	100.3			
Saturation, %	103.2			
Void ratio	0.6489			
Specimen diameter, in	2.85			
Specimen height, in	5.68			
Height/diameter ratio	1.99			

Description: Clay SI Silty Reddish Brown

GS= 2.65 Type: Shelby Tube


Project No.: 3-7590-0000-0000
 Date: 20 May 2003
 Remarks:
 Testing Sample @3.5ft

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

Fig. No.: 24 UC

UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

UNCONFINED COMPRESSION TEST

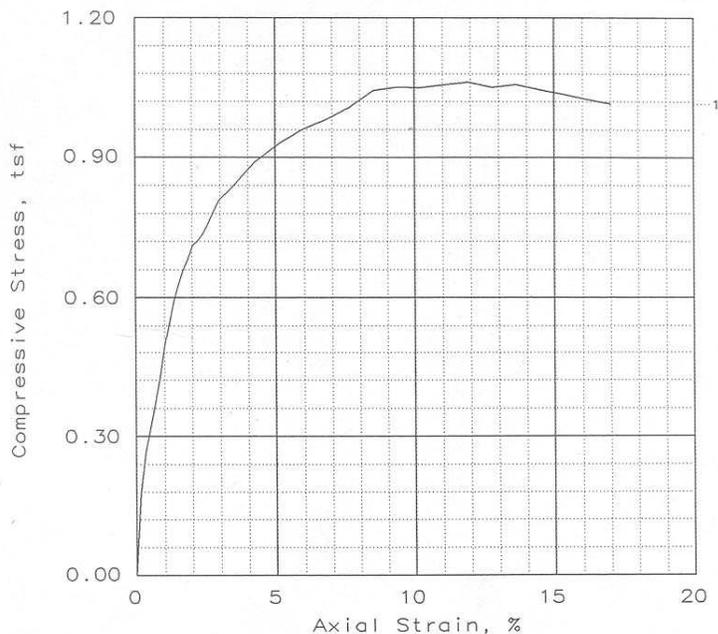


SAMPLE NO.:	1			
Unconfined strength, tsf	1.06			
Undrained shear strength, tsf	0.53			
Failure strain, %	11.9			
Strain rate, %/min	2.00			
Water content, %	23.8			
Wet density, pcf	125.4			
Dry density, pcf	101.3			
Saturation, %	99.4			
Void ratio	0.6332			
Specimen diameter, in	2.85			
Specimen height, in	5.87			
Height/diameter ratio	2.06			

Description: Clay SI Silty Brown GS= 2.65 Type: Shelby Tube

Project No.: 3-7590-0000-0000 Date: 17 May 2003 Remarks: Testing Sample @4.8ft Fig. No.: 25 UC	Client: RSP Architects Project: Ft. Knox Housing Location: Anderson Golf Course <div style="text-align: center;"> UNCONFINED COMPRESSION TEST AMEC Earth & Environmental </div>
--	--

UNCONFINED COMPRESSION TEST

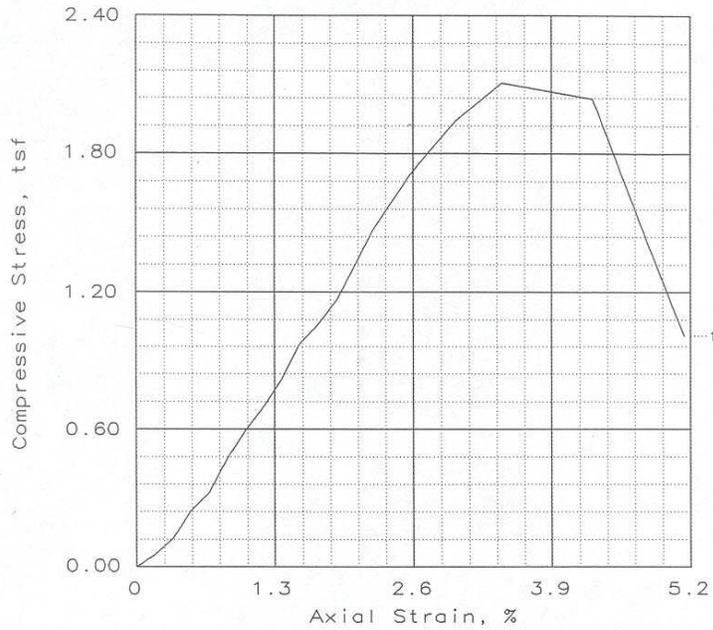

SAMPLE NO.:	1			
Unconfined strength, tsf	2.11			
Undrained shear strength, tsf	1.05			
Failure strain, %	3.4			
Strain rate, %/min	2.00			
Water content, %	26.6			
Wet density, pcf	124.4			
Dry density, pcf	98.2			
Saturation, %	103.1			
Void ratio	0.6839			
Specimen diameter, in	2.85			
Specimen height, in	5.83			
Height/diameter ratio	2.05			

Description: Clay SI Silty Reddish Brown

GS= 2.65 Type: Shelby Tube

Project No.: 3-7590-0000-0000
 Date: 17 May 2003
 Remarks:
 Testing Sample @5.3ft

 Fig. No.: 25aUC

Client: RSP Architects
 Project: Ft. Knox Housing
 Location: Anderson Golf Course

 UNCONFINED COMPRESSION TEST
AMEC Earth & Environmental

